

COX

Research and Technology, Inc.


OPTI-OA4A
OPTI-FLOAT® LEVEL DETECTOR
4 FLOAT OPEN ASSEMBLY

Cox Research and Technology, Inc.
PO Box 77808
Baton Rouge, LA. 70879
(225) 756-3271 Fax (225) 755-1030

OPTI-OA4A

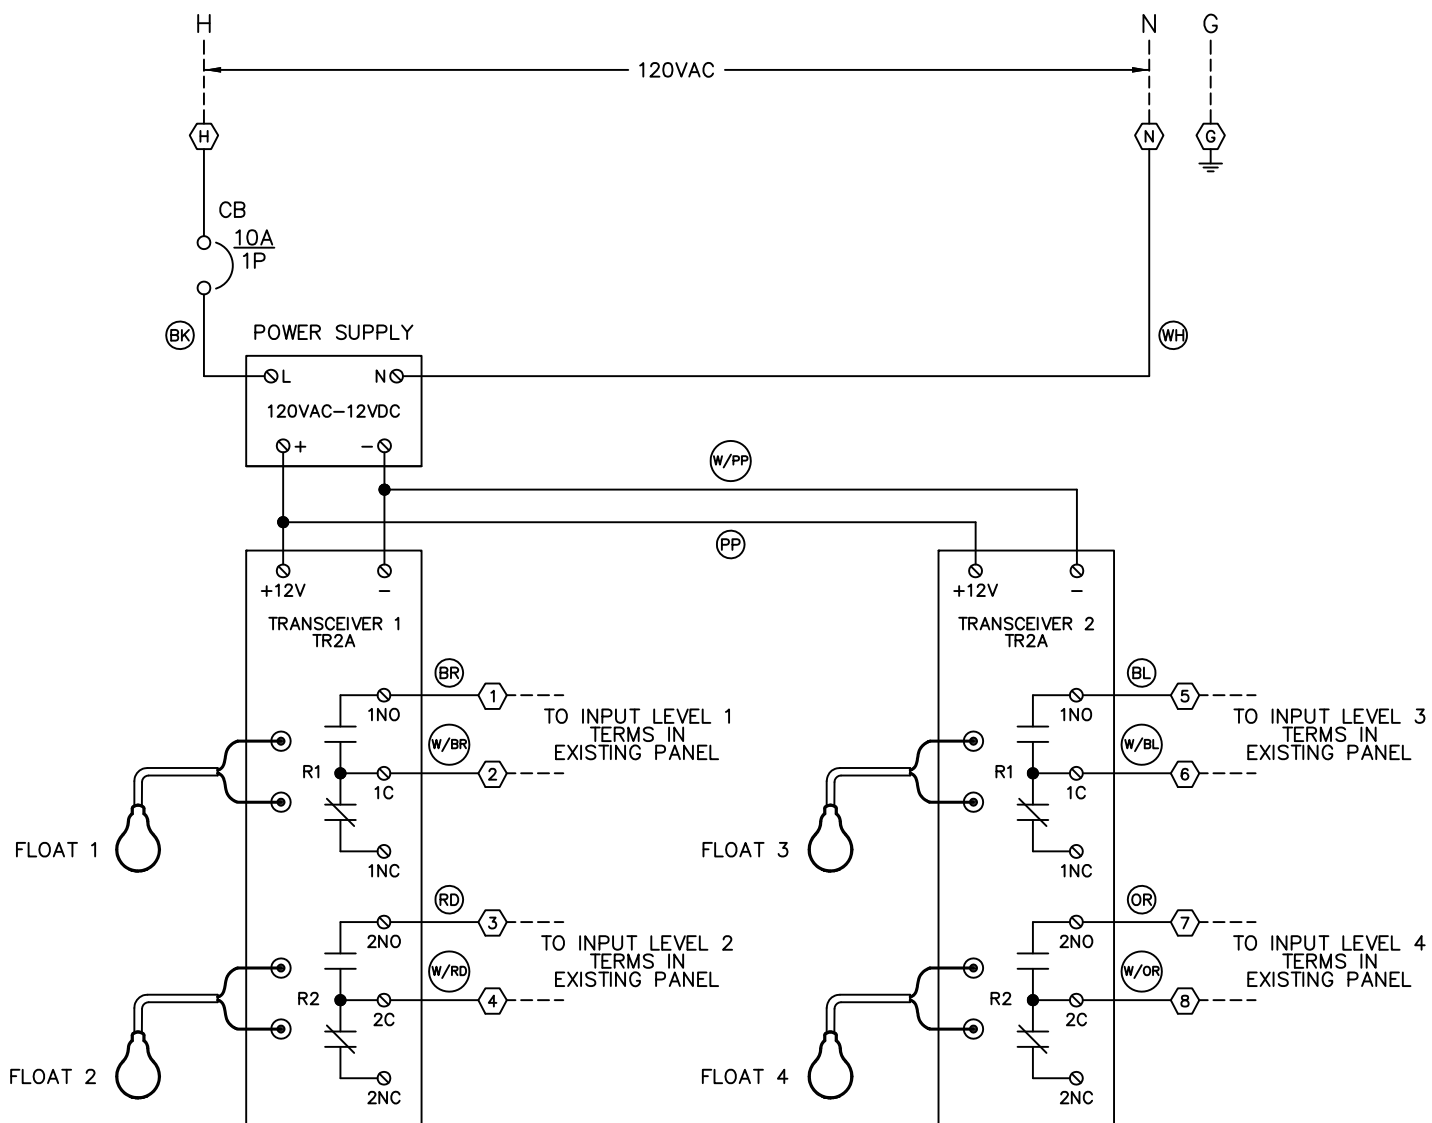

	Drawing Title						
	CONTROL DIAGRAM	OPTI-OA4		TR2 REPLACE TO TR2A		02/26/19	C.C.
DATE: 01/30/19		REFERENCE DRAWING	NO.	REVISION - LOCATION	ECN	DATE	BY
		S/N	Sales Engineer C.C.	Application Engineer C.C.	DRAWN BY: BMF	APPROVED	
	Project Title	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70879	PURCHASE ORDER NUMBER	
	OPTI-OA4A				Ph. (225) 756-3271 Fax (225) 755-1030	DRAWING NUMBER OPTI-OA4A	
SCALE: N.T.S.						SHEET NUMBER 1	

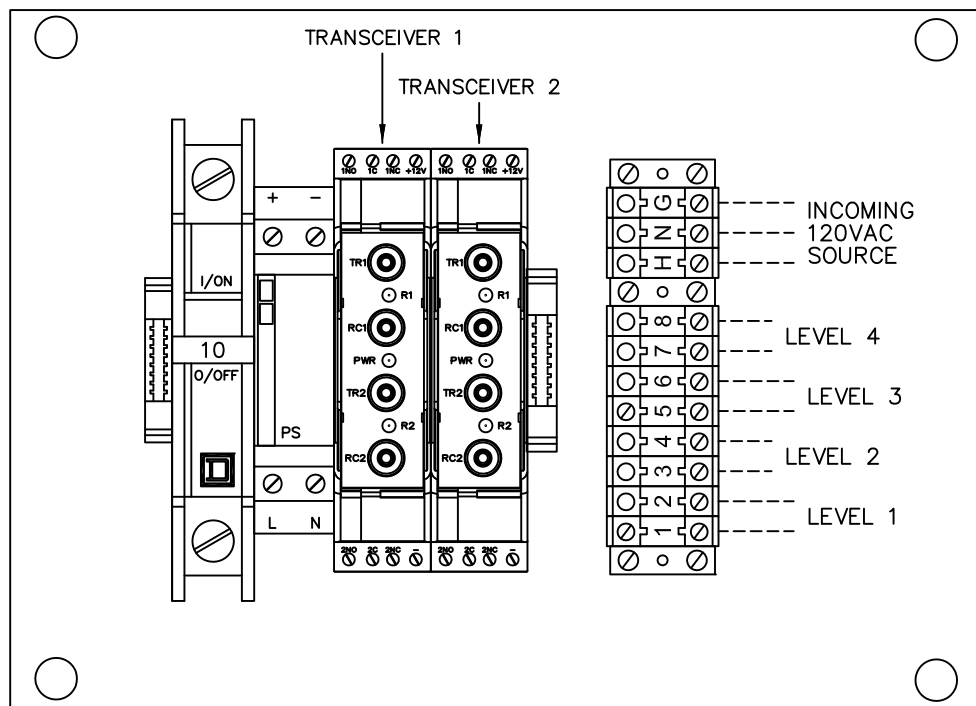


2 DUAL TRANSEIVERS (FOR 4 FLOATS) 6"W X 4.5"H X 4.75"D
 RECOMMENDED CLEARANCE FOR CABLE ENTRY IN FRONT OF TRANSEIVER IS 1" MINIMUM.
 FOR PROPER OPERATION INCOMING GROUND REQUIRED
 KEEP PANEL POWERED OFF UNTIL OPTI-FLOAT ARE COMPLETELY CONNECTED

	Drawing Title						
	EXTERNAL CONNECTIONS	OPTI-OA4		TR2 REPLACE TO TR2A		02/26/19	C.C.
		REFERENCE DRAWING		NO.		REVISION - LOCATION	
DATE:	Project Title	S/N	Sales Engineer	Application Engineer		DRAWN	
01/30/19			C.C.	C.C.		BY: BMF	APPROVED
	OPTI-OA4A	<div style="text-align: center;"> COX Research and Technology, Inc. </div>		P.O. Box 77808 Baton Rouge, LA 70879 Ph. (225) 756-3271 Fax (225) 755-1030		PURCHASE ORDER NUMBER	
SCALE:						DRAWING NUMBER	
N.T.S.						OPTI-OA4A	
						SHEET NUMBER	
						2	

The OPTI-FLOAT[®] TR2A Transceiver

Release Date
January 2019

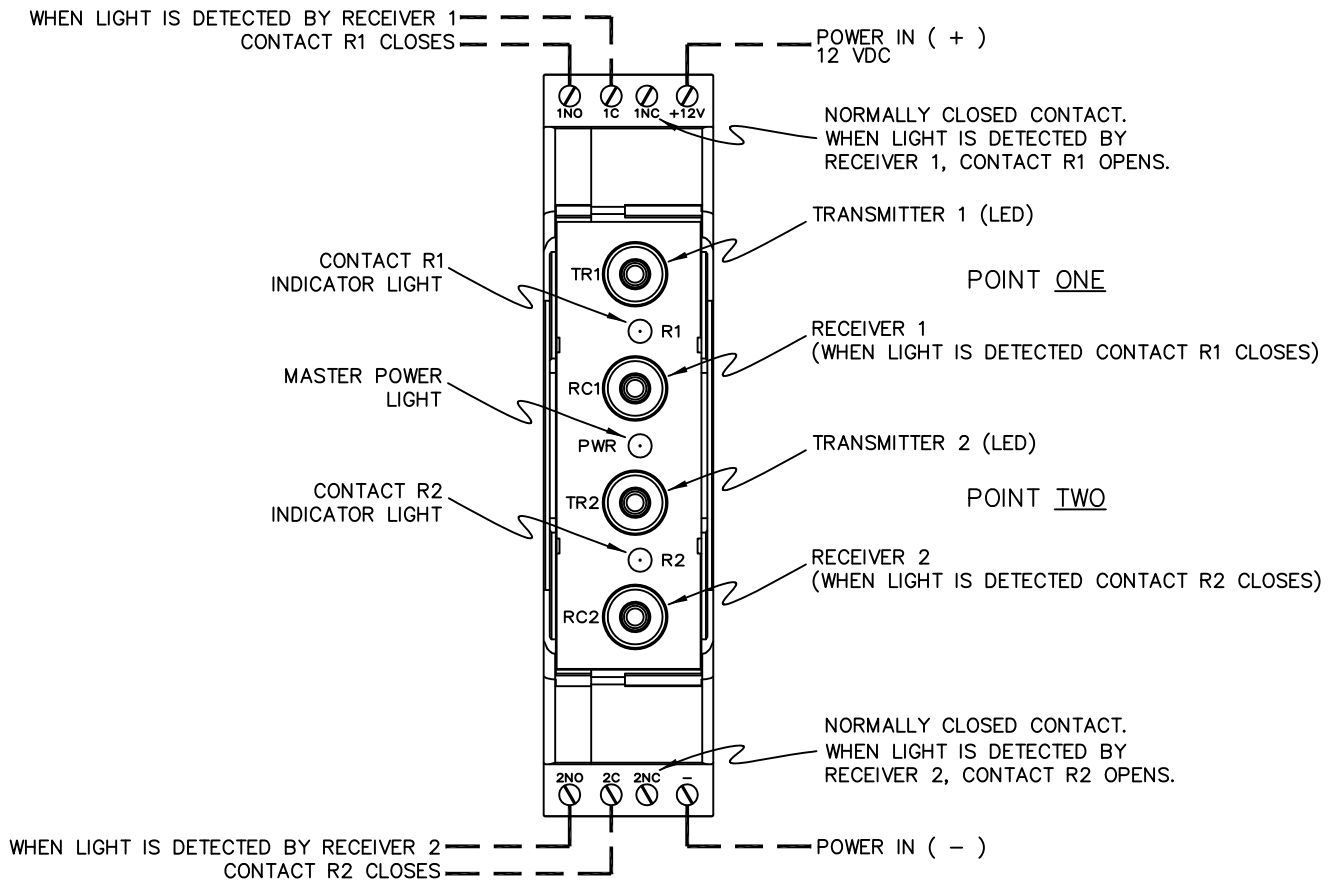

	Drawing Title <div>TRANSCEIVER</div>							
			OPTI-OA4		TR2 REPLACE TO TR2A		02/26/19	C.C.
		REFERENCE DRAWING	NO.	REVISION - LOCATION		ECN	DATE	BY
DATE: 01/30/19		S/N	Sales Engineer C.C.	Application Engineer C.C.	DRAWN BY: BMF	APPROVED BY: DATE:		
	Project Title <div>OPTI-OA4A</div>	<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70879 Ph. (225) 756-3271 Fax (225) 755-1030	PURCHASE ORDER NUMER		
						DRAWING NUMBER OPTI-OA4A		
SCALE: N.T.S.						SHEET NUMBER 3		